


METHOD 2 - SHEATHING REINFORCEMENT TWO SIDES

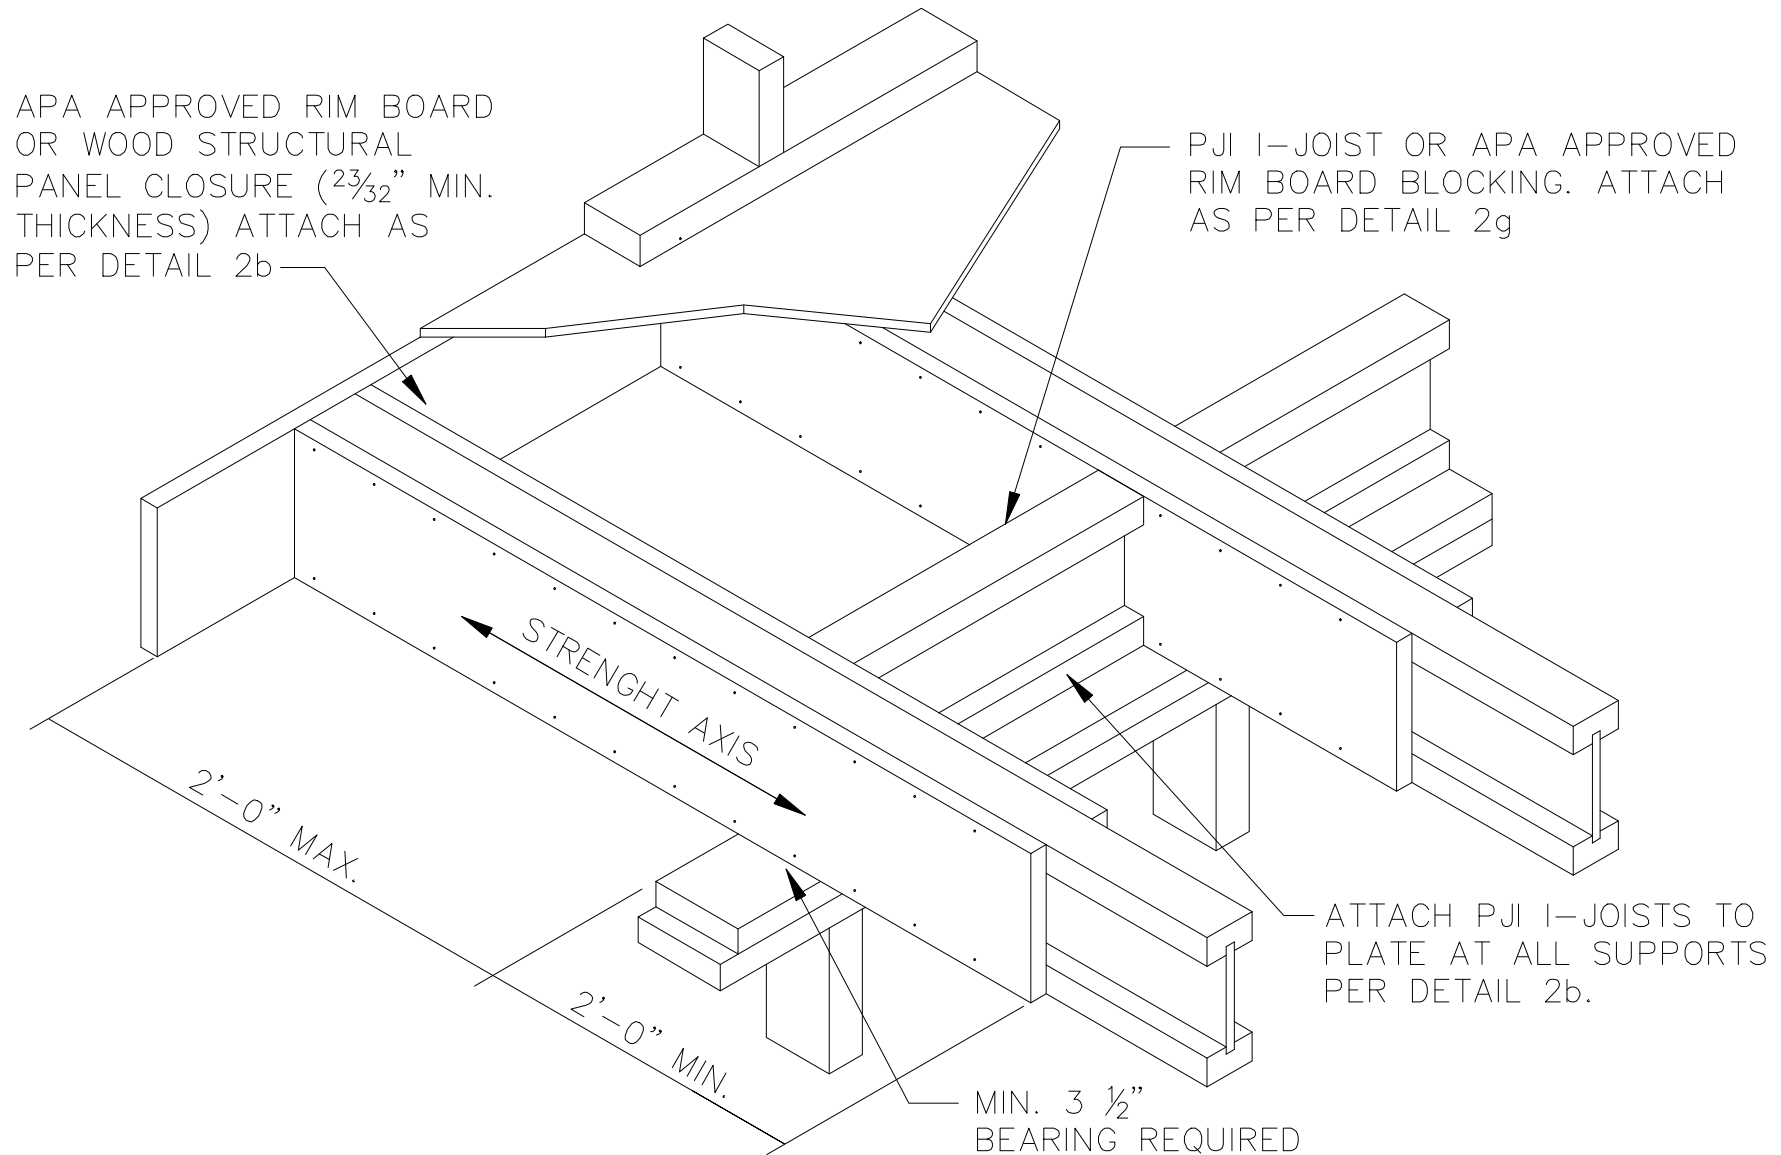

NOTE:

MIN. $2\frac{3}{32}$ " THICK APA SPAN RATED SHEATHING 48/24 OSB REQUIRED ON SIDE OF JOIST. DEPTH SHALL MATCH FULL HEIGHT OF JOIST. NAIL BOTH TOP AND BOTTOM FLANGES w/ $2\frac{1}{2}$ " NAILS @ 6" c/c OFFSET NAIL PATTERN 3" AT REINFORCEMENT ON OPPOSITE FACE. INSTALL WITH STRENGTH AXIS HORIZONTAL AS SHOWN. ATTACH PJI TO PLATE AS PER DETAIL 2b